

# Informationen

## zur Zertifizierung nach Baustoffklasse DIN 4102-1 – B1

**Stoff** • tokio OF1

Farb.-Nr.

086.xx

**Prüfzeugnis** **PZ-Hoch-230664**

**Gültigkeit** 31.05.2028

**Bestätigung** Die Firma erfal bestätigt, dass diesen Qualitäten das Prüfzeugnis **PZ-Hoch-230664** zugrunde liegt.



Jörg Erler  
Geschäftsführer

erfal steht für Qualität Made in Germany.

Um eine lange Lebensdauer unter Wahrung der ursprünglichen Produkteigenschaften zu gewährleisten, sollten Sie die mitgelieferten Pflege- und Reinigungsmöglichkeiten unbedingt beachten.

Bei Fragen zur Pflege unserer Stoffe melden Sie sich bitte bei:

erfal GmbH & Co. KG  
Gewerbering 8  
D - 08223 Falkenstein

Fon +49 (0) 3745 750 0  
Fax +49 (0) 3745 750 299  
info@erfal.de

Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch  
Testing, supervising and certifying body, authorized by the building supervision authority

# TEST REPORT

## PZ-Hoch-230664

for the proof of Fire behaviour according to DIN 4102, part 1

Translation of the German test report – no guarantee for translation of technical terms

<b>company</b>	<b>COULISSE B.V.</b> Vonderweg 48 <b>NL-7468DC Enter</b>
<b>description of samples</b>	fabric consisting of Polyester, with PVC-coating and additional PU-coating on one side, in 3 different colours
<b>name of the material</b>	„SCR-3001“
<b>sampling</b>	by the company itself
<b>content of request</b>	Proof of flammability to classify building materials to class B1 "schwerentflammbar" according to DIN 4102, part 1
<b>validity of test report</b>	31.05.2028
<b>result</b>	<b>The examined product meets in any colour the requirements of class B1 for "schwerentflammbar" (hardly flammable) building materials according to DIN 4102, part 1 (May 1998) , suspended freely or with distance of &gt;40 mm to same or other plain materials.</b>

This test report includes 5 pages and 6 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 9, Ziffer1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval) or by
- "allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by
- "Zustimmung im Einzelfall" (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.

## **1. Description of test material in condition as delivered**

**PN 37052:** "SCR-3001" colour: white

- fabric consisting of 30% Polyester, coated with 70% PVC and additional coated with PU on one side -

There is no difference between side A and side B.

characteristic values determined by the test laboratory:

area weight: about 497 g/m<sup>2</sup> thickness: about 0,64 mm

**PN 37053:** "SCR-3001" colour: brown-black

- fabric consisting of 30% Polyester, coated with 70% PVC and additional coated with PU on one side -

There is no difference between side A and side B.

characteristic values determined by the test laboratory:

area weight: about 505 g/m<sup>2</sup> thickness: about 0,64 mm

**PN 37054:** "SCR-3001" colour: white-grey

- fabric consisting of 30% Polyester, coated with 70% PVC and additional coated with PU on one side -

There is no difference between side A and side B.

characteristic values determined by the test laboratory:

area weight: about 512 g/m<sup>2</sup> thickness: about 0,68 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

## **2. Preparation of samples**

The samples were kept in climate chamber 23/50 until they reached constant weight.

## **3. Arrangement of samples** mounting: freely suspended

#6498	flaming side A in warp direction	brown-black
#6499	flaming side B in weft direction	brown-black
#6504	flaming side B in weft direction	white
#6505	flaming side B in weft direction	white-grey

## **4. Date of test** CW 22 in 2023

**5. Results**

The test has been examined according to DIN 4102 (Mai 1998)

line no.	Measurement	Result with the tested specimen					Dim.
		#6498	#6499	#6504	#6505	---	
	Test number						
	flamed direction	warp	weft	weft	weft	---	
	flamed side	A	B	B	B	---	
	colour of fabric	brown-black	white	white-grey	---		
1	Number of specimen arrangement acc. to DIN 4102/T15, schedule 1	1	1	1	1	---	
2	Maximum flame height above bottom edge of the specimen	60	60	60	60	---	
3	Time <sup>1)</sup>	0:08	0:07	0:09	0:09	---	cm min:s
4	Burn through / melting Time <sup>1)</sup>	0:09	0:10	0:10	0:10	---	min:s
5	Observations on the back side of the specimen Flames / Glowing	---	---	---	---	J.	
6	Time <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
7	Change of color	---	---	---	---	J.	
8	Time <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
9	Extent	---	---	---	---	J.	
10	sporadic falling of burning droplets <sup>2)</sup>	---	---	---	---	J.	
11	continuous falling of burning droplets <sup>2)</sup>	---	---	---	---	J.	
12	Start <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
13	Extent	---	---	---	---	J.	
14	sporadic falling of burning droplets <sup>2)</sup>	---	---	---	---	J.	
15	continuous falling of burning droplets <sup>2)</sup>	---	---	---	---	J.	
16	Afterflame time at the bottom of the sieve (max.)	J.	J.	J.	J.	J.	min:s
17	Impairment of the burner by dropping or falling material: Time <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
18	Premature end of test	1:00	2:40	3:25	1:55	J.	
19	Final occurrence of burning at the specimen <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
20	Time of eventually end of test <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
21	Afterflame after end of test Time <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
	Number of specimen	---	---	---	---	J.	
	Front side of specimen <sup>2)</sup>	---	---	---	---	J.	
	Back side of specimen <sup>2)</sup>	---	---	---	---	J.	
	flame length	---	---	---	---	J.	cm

line no.	Measurement	Result with the tested specimen					Dim.
		#6498	#6499	#6504	#6505	---	
	Test number						
	flamed direction	warp	weft	weft	weft		
	flamed side	A	B	B	B	---	
	<u>Afterglow after end of test</u>						
22	Time <sup>1)</sup>	J.	J.	J.	J.	J.	min:s
23	Number of specimen	J.	J.	J.	J.	J.	
	<u>Place of appearance</u>						
24	Lower half of the specimen <sup>2)</sup>	J.	J.	J.	J.	J.	
25	Upper half of the specimen <sup>2)</sup>	J.	J.	J.	J.	J.	
26	Front side of specimen <sup>2)</sup>	J.	J.	J.	J.	J.	
27	Back side of specimen <sup>2)</sup>	J.	J.	J.	J.	J.	
	<u>Density of smoke</u>						
28	≤ 400 % * min	36	22	22	24	---	% * min
29	> 400 % * min <sup>4)</sup>	J.	J.	J.	J.	J.	% * min
30	Diagram: encl. no.	1	2	3	4	---	
	<u>Residual lengths: individual value</u> <sup>3)</sup>						
31	Specimen 1	65	61	64	64	---	cm
	Specimen 2	64	63	65	65	---	cm
	Specimen 3	61	63	63	62	---	cm
	Specimen 4	65	66	66	67	---	cm
32	<u>Average value, individual test</u> <sup>3)</sup>	64	63	65	65	---	
33	<u>Photo of specimen in enclosure no.</u>	1	2	3	4	---	
34	<u>Flue gas temperature</u>	115	119	118	118	---	°C
35	Maximum of average value						
	Time <sup>1)</sup>	09:48	10:00	09:24	10:00	---	min:s
36	Diagram: encl. no.	1	2	3	4	---	
37	Remarks: - none -						

<sup>1)</sup> indication of times: from the begin of testing procedure

<sup>2)</sup> checked off if applicable

<sup>3)</sup> indication of carrier/foam layer separated in case of fire-proofing agents

<sup>4)</sup> very strong development of smoke

## 6. Explanations concerning the testing procedure

There were no additional tests proceeded because of the residual length of  $\geq$  than 45 cm.

## 7. Summary of results and additional establishments to Fire Behaviour

linen o	measurement	Result with the tested specimen					dime nsion
		#6498	#6499	#6504	#6505	---	
	flamed direction flamed side	warp A	weft B	weft B	weft B	---	
	colour of fabric	brown-black	white	white-grey			
1	residual length	64	63	65	65	---	cm
2	max. smoke temperature	115	119	118	118	---	°C
3	density of smoke - integral	36	22	22	24	--	%min
4	remarks: none						

According to DIN 4102, part 1, "schwerentflammbar" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 5 & 6).

## 8. Special remarks


- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
  - regular building materials for the required proof of accordance
  - for not regular building materials for the required proof of applicability

## 9. Validity

This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 01.06.2023

clerk in charge:


  
(Dipl.-Ing.(FH) Jürgen Hammer)



Head of the test laboratory:

  
(Dipl.-Ing.(FH) Andreas Hoch)

„Brandschacht“-test #6498

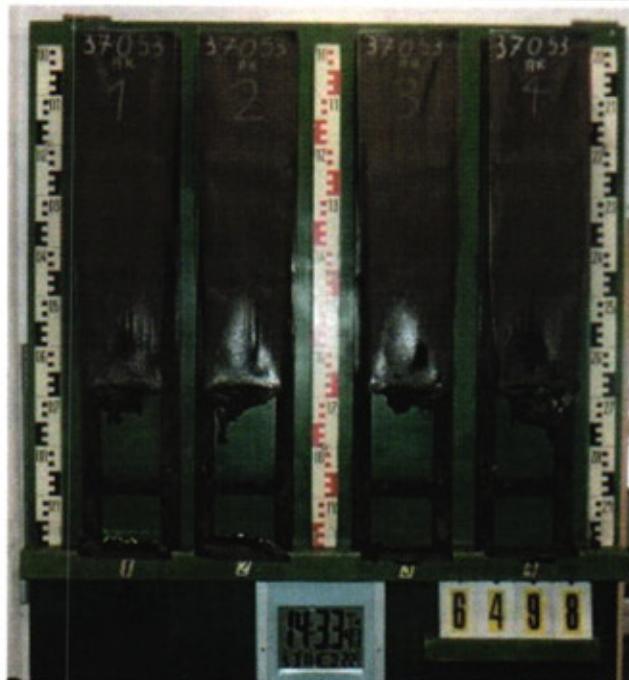


measurement


#6498, PN37053: COULISSE, "SCR-3001", A + K

Max. flue temperature: 115°C, Smoke density integral: 36%min

Residual length: 64 cm

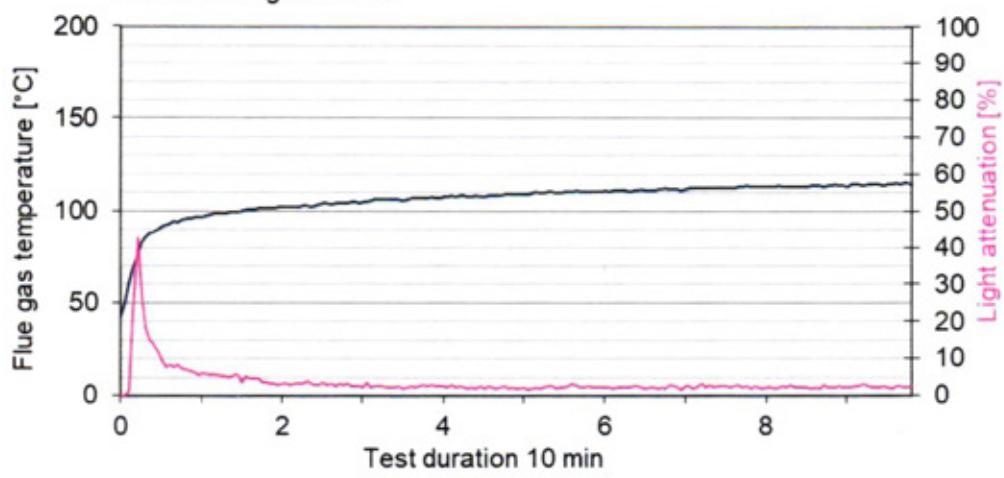

„Brandschacht“-test #6499

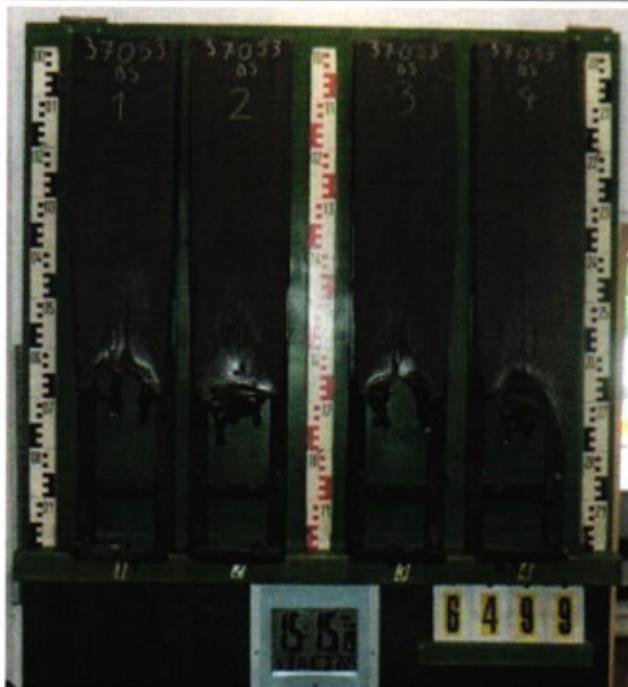


measurement


#6499, PN37053: COULISSE, "SCR-3001", B + S

Max. flue temperature: 119°C, Smoke density integral: 22%min

Residual length: 63 cm

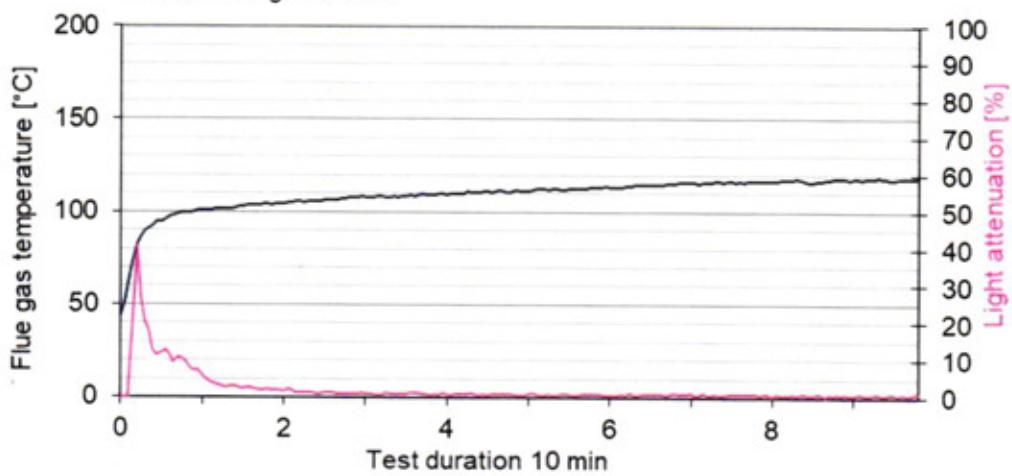

„Brandschacht“-test #6504

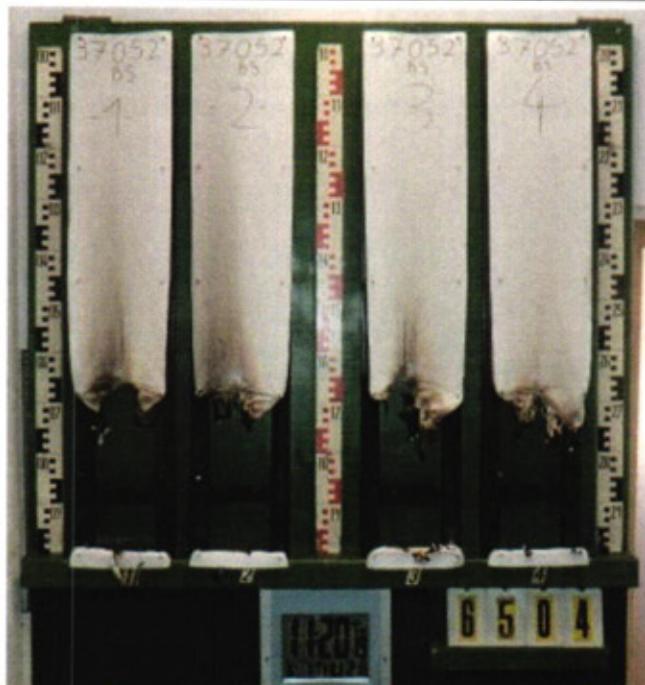


measurement


#6504, PN37052: COULISSE, "SCR-3001", B + S

Max. flue temperature: 118°C, Smoke density integral: 22%min

Residual length: 65 cm

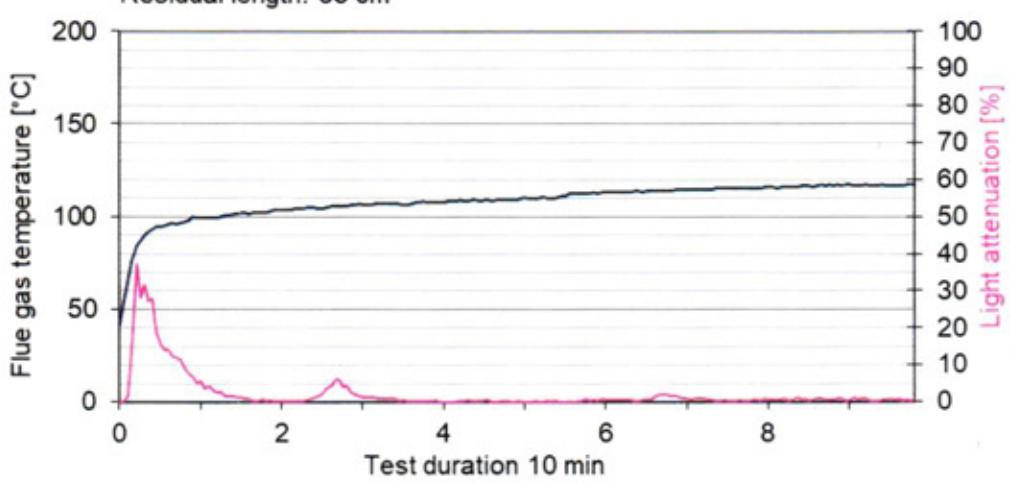

„Brandschacht“-test #6505

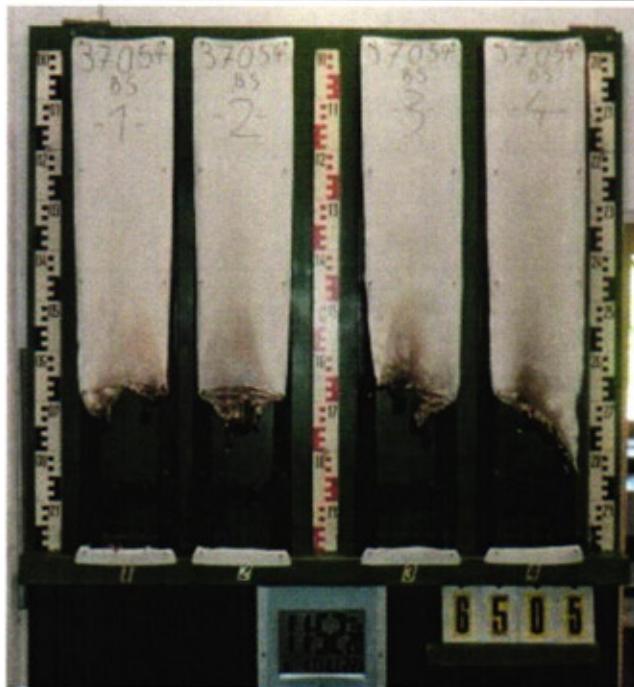


measurement

#6505, PN37054: COULISSE, "SCR-3001", B + S

Max. flue temperature: 118°C, Smoke density integral: 24%min

Residual length: 65 cm

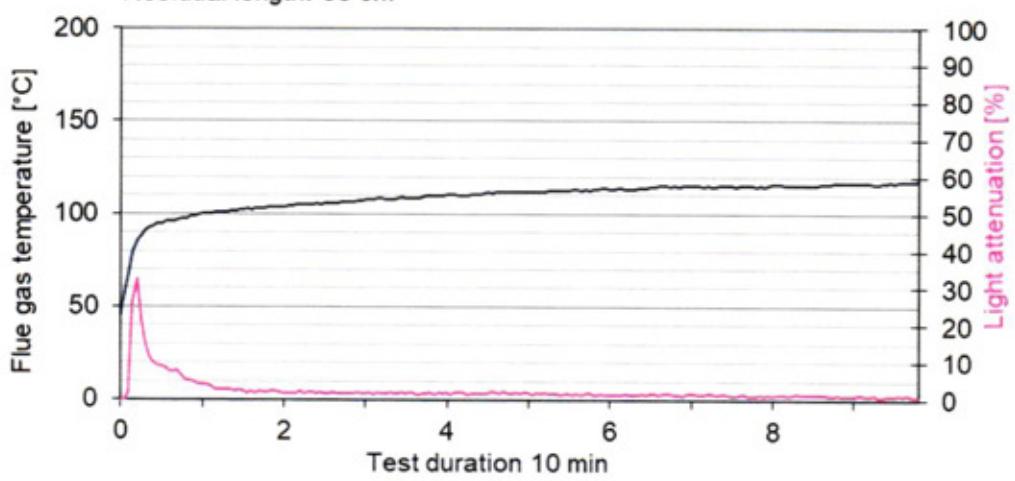

**Test for normal flammability  
classifying B2 according to DIN 4102**

1. Description of test material in condition as delivered look at page 2

2. Preparation of samples

Out of the material there have been cut samples for the ignitability apparatus.

The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples -freely suspended-

Flaming in warp and weft direction / side A and side B

4. Date of test CW 20 in 2023

5. Results

PN 37053: flaming side B in warp direction		edge-test						surface-test						Dim
samples no.		1	2	3	4	5	6	1	2	3	4	5	6	
ignition <sup>1)</sup>		1	1	1	1	1	--	4	--	--	--	--	--	s
reaching the mark of measurement <sup>1)2)</sup>		-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	s
max. flame height		13	13	12	12	13	--	4	--	--	--	--	--	cm
time		15	15	15	15	15	--	15	--	--	--	--	--	
self cessation of the flames end of afterflame <sup>1)</sup>		17	15	15	15	18	--	15	--	--	--	--	--	s
end of glowing <sup>1)</sup>		31	17	26	29	27	--	-/-	--	--	--	--	--	s
flames were extinguished after <sup>1)</sup>		-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	
smoke development (visual)		heavy						moderate						./.
dropping of burning material during 20 s <sup>1)</sup>		-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	s
Appearance after test: burned out till max. height 12 cm x width 4 cm														

PN 37053: additional tests		edge-test						surface-test						Dim
samples no.		1	2	3	4	5	6	1	2	3	4	5	6	
arrangement of samples side / direction		A/K	A/S	B/S	--	--	--	A/K	A/S	B/S	--	--	--	
ignition <sup>1)</sup>		1	1	1	--	--	--	4	4	4	--	--	--	s
reaching the mark of measurement <sup>1)2)</sup>		-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
max. flame height		12	12	13	--	--	--	6	8	6	--	--	--	cm
time		15	15	11	--	--	--	15	15	15	--	--	--	
self cessation of the flames end of afterflame <sup>1)</sup>		16	15	17	--	--	--	15	15	15	--	--	--	s
end of glowing <sup>1)</sup>		28	26	29	--	--	--	-/-	-/-	-/-	--	--	--	s
flames were extinguished after <sup>1)</sup>		-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
smoke development (visual)		heavy						moderate						
dropping of burning material during 20 s <sup>1)</sup>		-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
Appearance after test: burned out till max. height 12 cm x width 4 cm														

<sup>1)</sup> time mentioned from the beginning of the test <sup>2)</sup> during 20 Sec    -/- no appearance    -- no information

K: warp / S: weft

PN 37052: additional tests	edge-test						surface-test						Dim
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition <sup>1)</sup>	1	1	1	1	--	--	4	4	4	4	--	--	s
reaching the mark of measurement <sup>1)(2)</sup>	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
max. flame height	12	12	12	12	--	--	5	5	5	5	--	--	cm
time	15	15	15	15	--	--	15	15	15	15	--	--	
self cessation of the flames end of afterflame <sup>1)</sup>	15	19	16	16	--	--	15	15	15	15	--	--	s
end of glowing <sup>1)</sup>	35	34	31	33	--	--	-/-	-/-	-/-	-/-	--	--	s
flames were extinguished after <sup>1)</sup>	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
smoke development (visual)	moderate						moderate						
dropping of burning material during 20 s <sup>1)</sup>	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
Appearance after test: burned out till max. height 12 cm x width 4 cm													

PN 37054: additional tests	edge-test						surface-test						Dim
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition <sup>1)</sup>	1	1	1	1	--	--	4	4	4	4	--	--	s
reaching the mark of measurement <sup>1)(2)</sup>	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
max. flame height	12	12	12	11	--	--	4	4	4	4	--	--	cm
time	15	15	15	10	--	--	15	15	15	15	--	--	
self cessation of the flames end of afterflame <sup>1)</sup>	19	18	15	15	--	--	15	15	15	15	--	--	s
end of glowing <sup>1)</sup>	23	24	27	23	--	--	-/-	-/-	-/-	-/-	--	--	s
flames were extinguished after <sup>1)</sup>	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
smoke development (visual)	moderate						moderate						
dropping of burning material during 20 s <sup>1)</sup>	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
Appearance after test: burned out till max. height 10 cm x width 4 cm													

<sup>1)</sup> time mentioned from the beginning of the test <sup>2)</sup> during 20 Sec      -/- no appearance      -- no information

6. Remarks and explanations to the testing procedure - none -

7. Opinion concerning the dropping of burning material

The test for normal flammability shows no burning dripping material.